

LAMPIRAN

LAMPIRAN

KEPUTUSAN MENTERI NEGARA LINGKUNGAN HIDUP

NO. 58 TAHUN 1995 TANGGAL 21 DESEMBER 1995

Tabel 2. BAKU MUTU LIMBAH CAIR BAGI KEGIATAN RUMAH SAKIT

PARAMETER	KADAR MAKSIMUM
FISIKA	
Suhu	<30°C
KIMIA	
pH	6-9
BOD ₅	30 mg/l
COD	80 mg/l
TSS	30 mg/l
NH ₃ Bebas	0,1 mg/l
PO ₄	2 mg/l
MIKROBIOLOGIK	
MPN-Kumna Golongan Kolo/100 ml	10.000
RADIOAKTIVITAS	
³² P	7x10 ² Bq/L
³⁵ S	2x10 ³ Bq/L
⁴⁵ Ca	3x10 ² Bq/L
⁵¹ Cr	7x10 ⁴ Bq/L
⁶⁷ Ga	1x10 ³ Bq/L
⁸⁵ Sr	4x10 ³ Bq/L
⁹⁹ Mo	7x10 ³ Bq/L
¹¹³ Sn	3x10 ³ Bq/L
¹²⁵ I	1x10 ⁴ Bq/L
¹³¹ I	7x10 ⁴ Bq/L
¹⁹² Ir	1x10 ⁴ Bq/L
²⁰¹ Tl	1x10 ⁵ Bq/L


Grafik COD minggu 1

y vs x

(nilai COD vs hari)

Tabel nilai COD minggu 1

X	Y
2	40
4	40
6	39,6
8	41

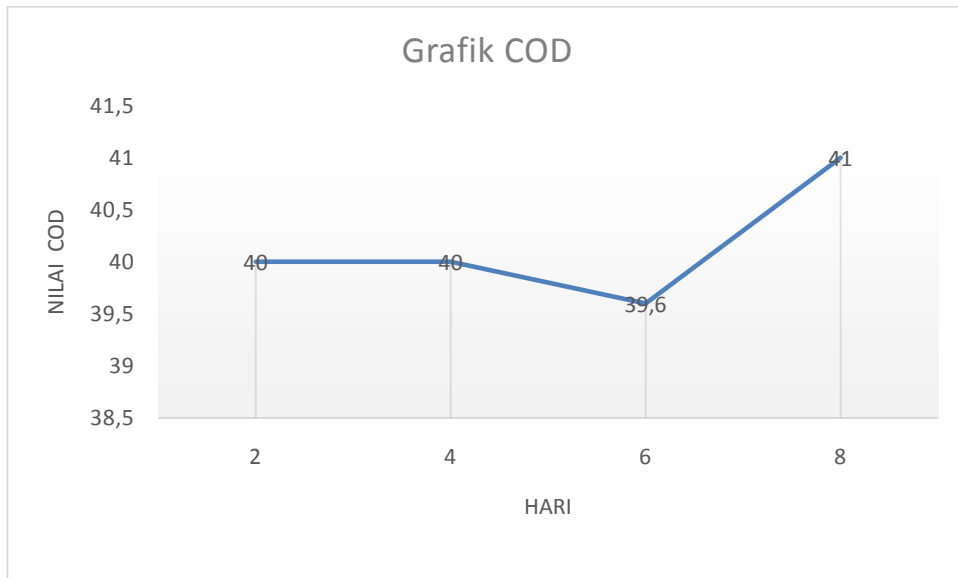


Grafik COD minggu 2

y vs x

(nilai COD vs hari)

Tabel COD minggu 2

X	Y
2	45,167
4	45,174
6	45,276
8	45,382

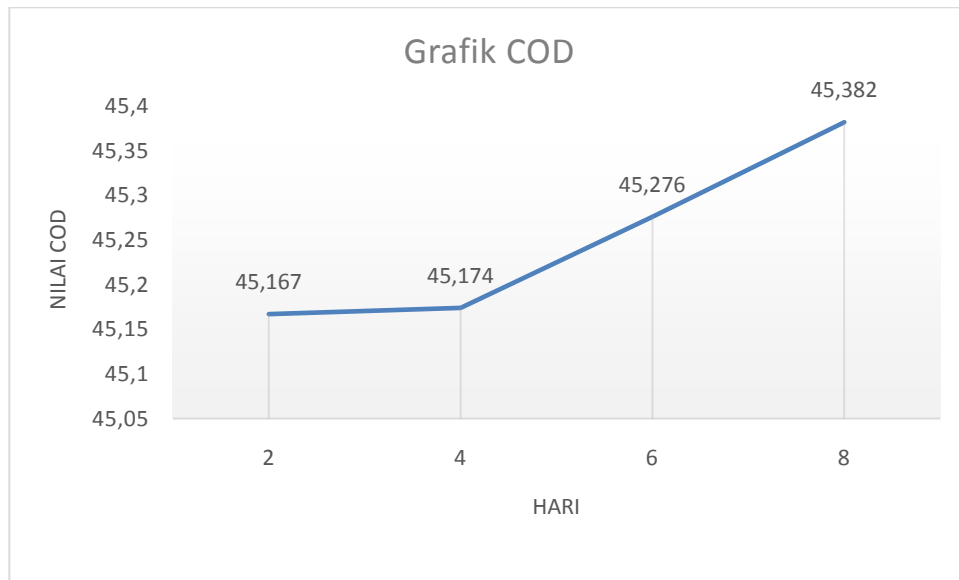


Grafik COD minggu 3

y vs x

(nilai COD vs hari)

Tabel nilai COD minggu 3

X	Y
2	53,45
4	53,5
6	53,628
8	53,654

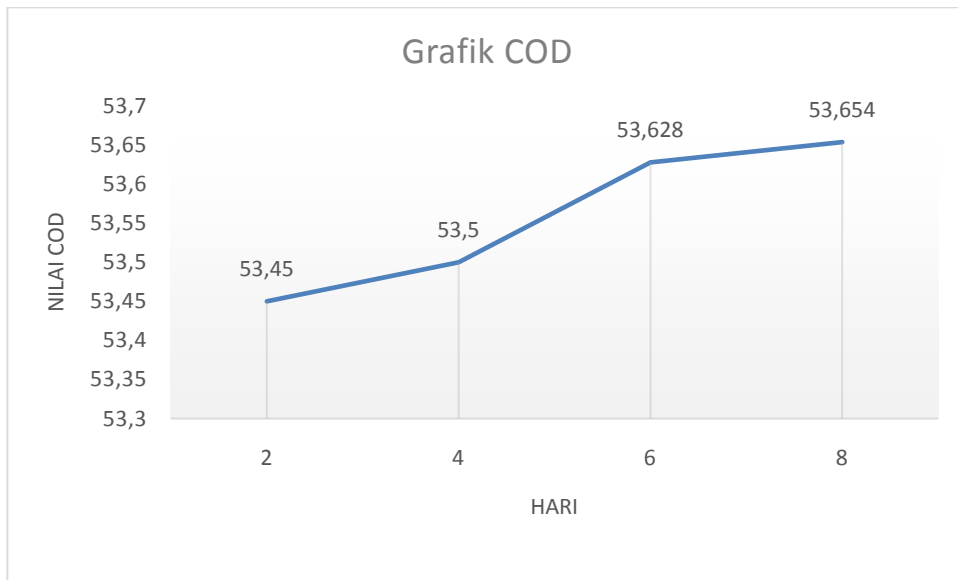

Grafik COD rata-rata

y vs x

(nilai COD vs minggu)

Tabel COD rata-rata tiap minggu

X	Y
1	40,15
2	45,249
3	53,558

